



1.1 TYPICAL UNISTRUT HOOD SUPPORT DETAILS

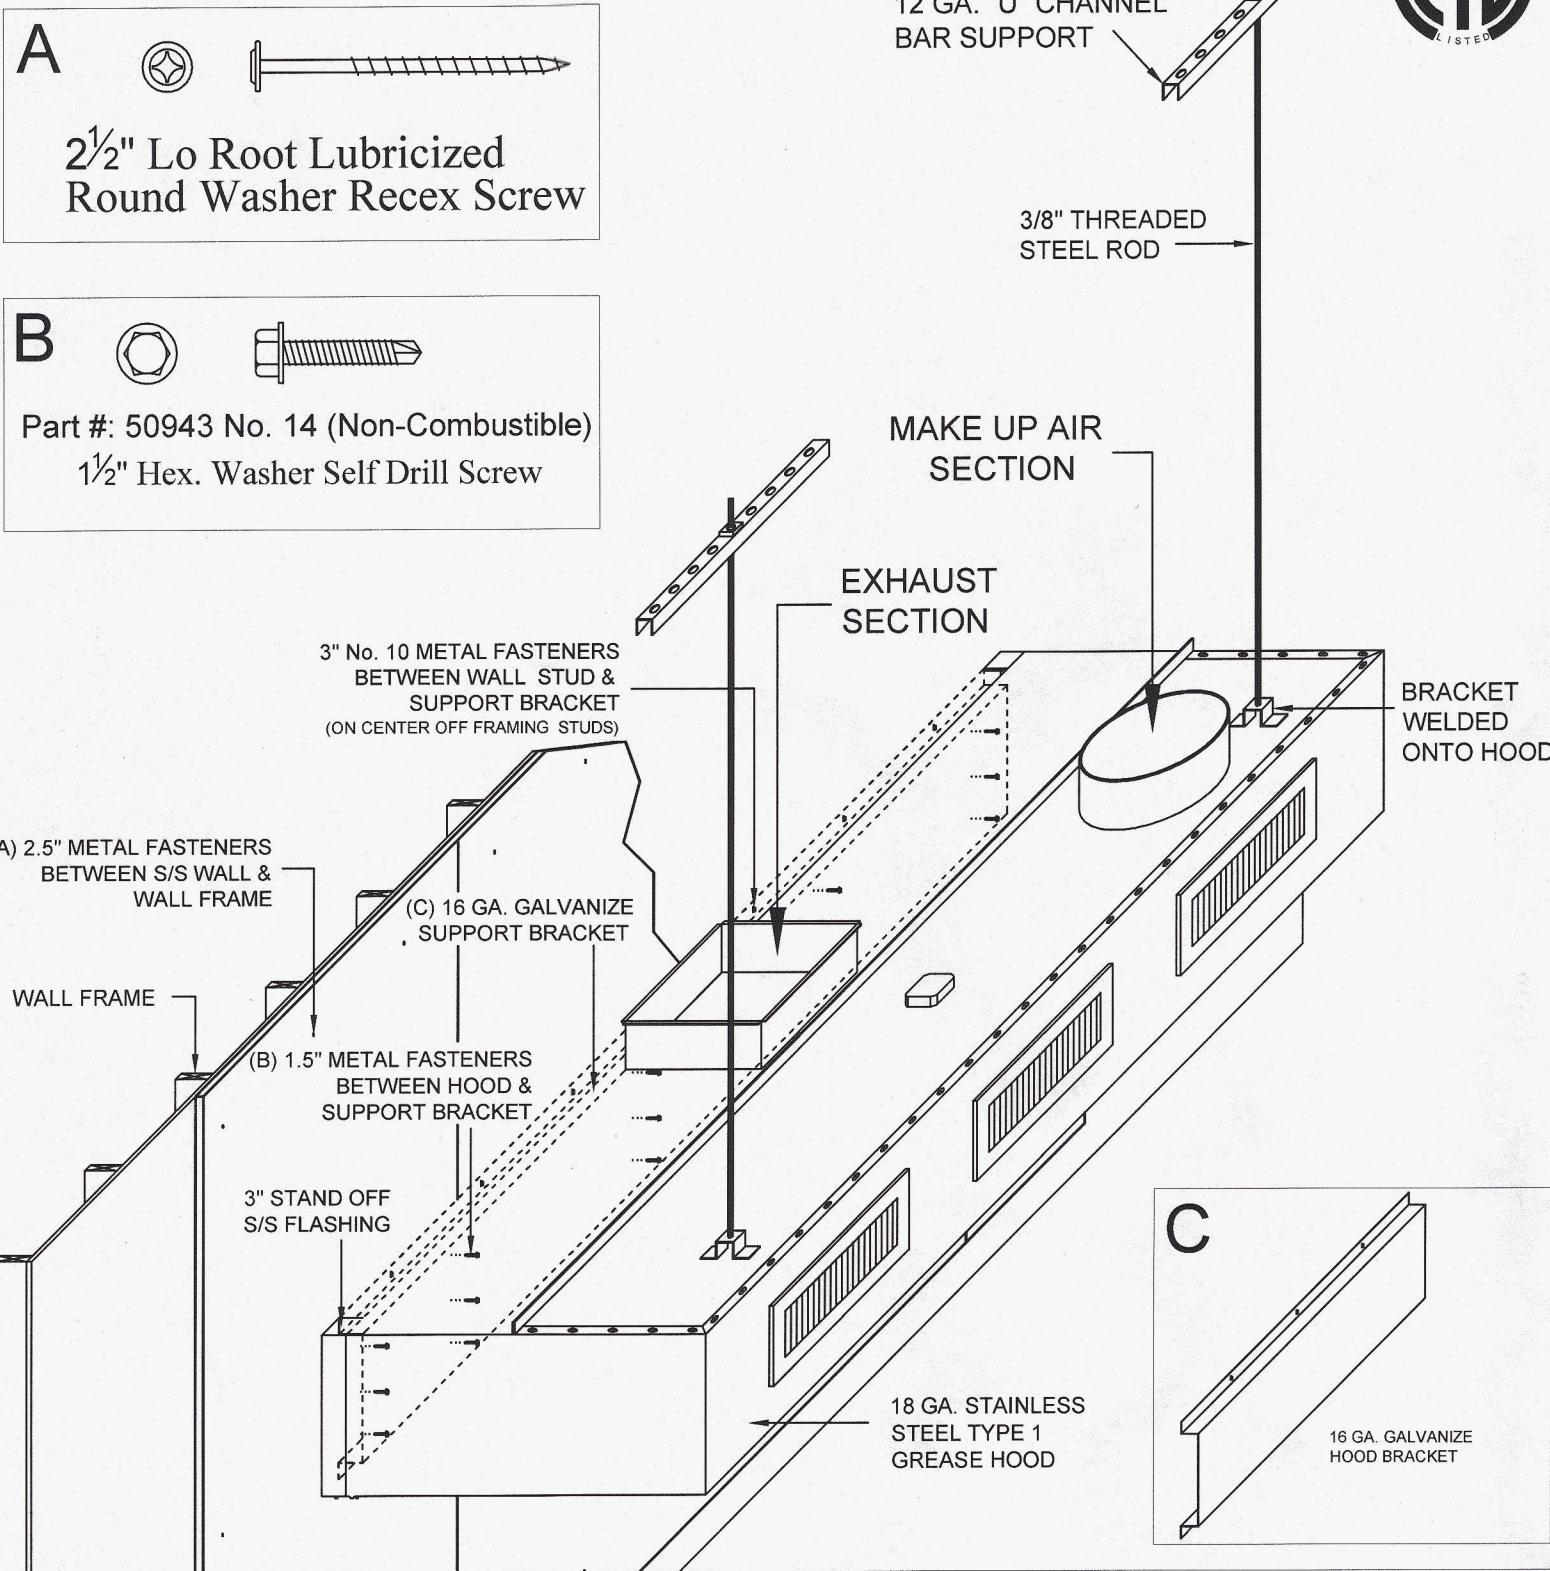



1.2

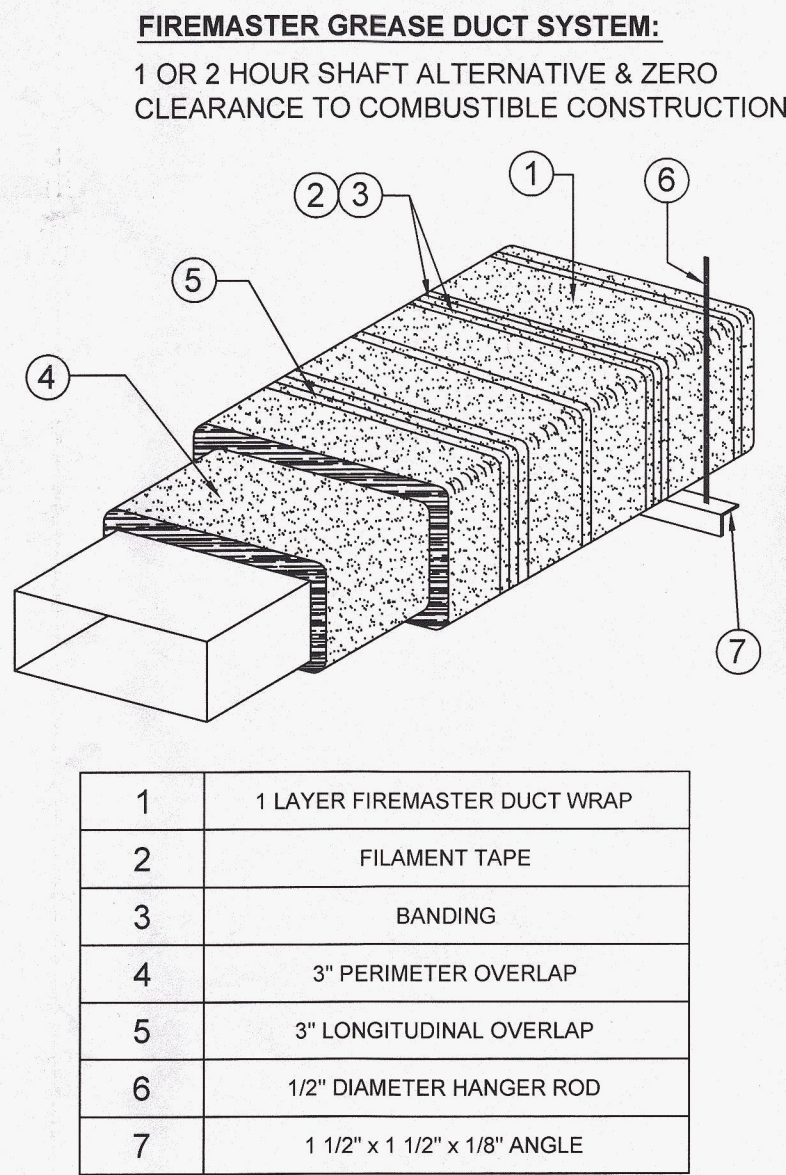

NOTES:


1. THE EXHAUST FAN & MAKE UP AIR SYSTEM WILL BE CONNECTED BY AN ELECTRICAL INTERLOCKING SWITCH FOR SAME TIME OPERATION.
 2. ALL EQUIPMENT SHOWN ON THIS DRAWING SHALL BE AS SPECIFIED OR EQUAL.
 3. THE PROPOSED WALL TO BE CONSTRUCTED TO MEET THE FIRE CODES FOR TYPE 1 HOOD (1 HR. FIRE RESISTIVE SHIELD).
 4. STAINLESS STEEL SHEET SHALL COVER THE ENTIRE COOKING AREA.
 5. ALL HOOD, DUCT JOINS, & SEAMS SHALL BE EXTERNAL GREASE TIGHT WELD.
 6. EXHAUST FAN SHALL BE 40" (MIN.) DISCHARGE ABOVE ROOF.
 7. MIN. DISTANCE BETWEEN EXHAUST FAN & MAKE UP AIR SHALL BE NO LESS THAN 10'.
 8. FIRE SUPPRESSION SYSTEM WILL BE UNDER SEPERATE PERMIT.
- SCOPE OF WORK:**
INSTALL ONE 12 COMMERCIAL KITCHEN (TYPE 1) GREASE HOOD, ONE EXHAUST FAN, ONE MAKE UP AIR UNIT, & RELATED DUCT WORK FOR BOTH FANS.
- PROJECT INFORMATION:**
TENANT: JASMIN MEDITERRANEAN KITCHEN
11613 124th AVE NE
KIRKLAND, WA 98034
PROPERTY OWNER: KIM SANG M + CHUN O
PARCEL TAX ACCOUNT: 282605-9169
LEGAL DESCRIPTION: S 300 FT OF E 1/4 OF SE 1/4 OF SW 1/4 LESS W 142 FT LESS CO RDS LESS PSH # 1

* Hood exhaust shall automatically operate when ever cooking operations occur. via heat sensors and interlock w/ cooking appliances

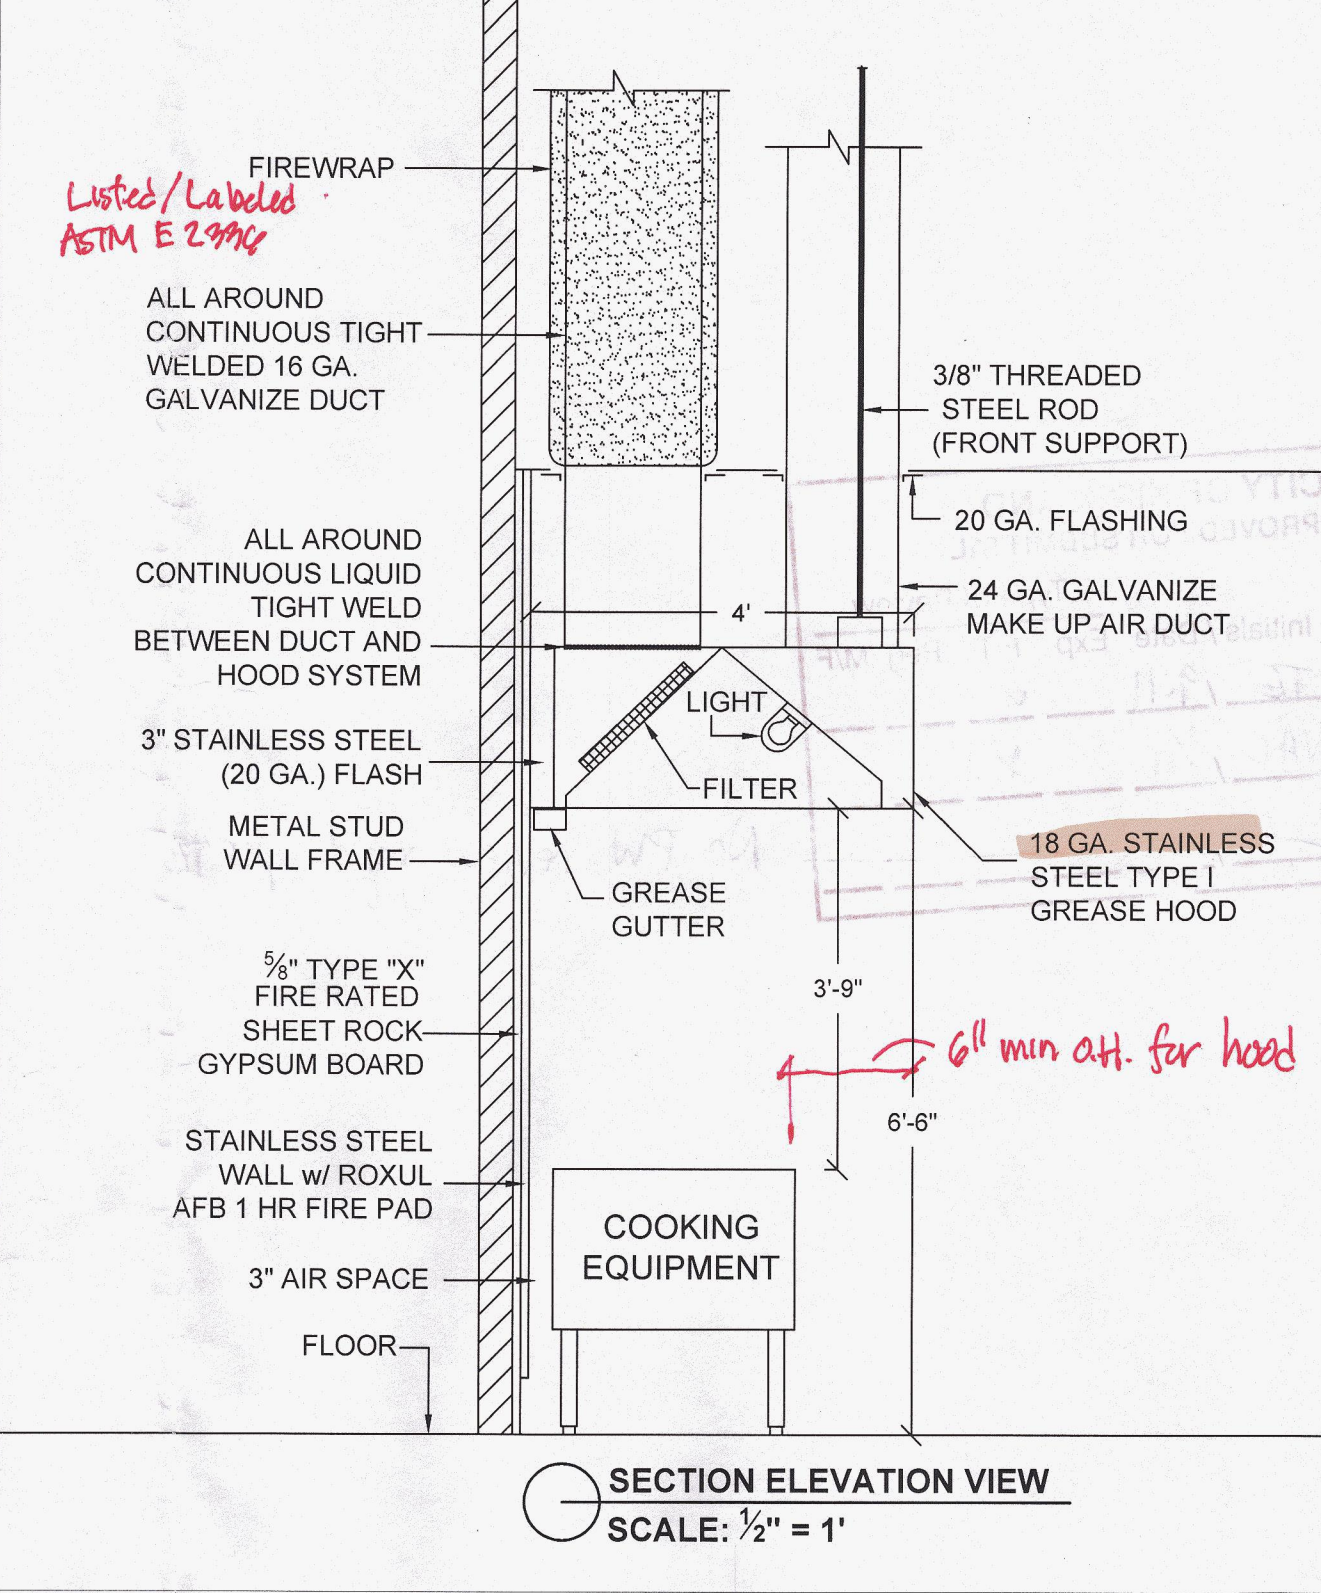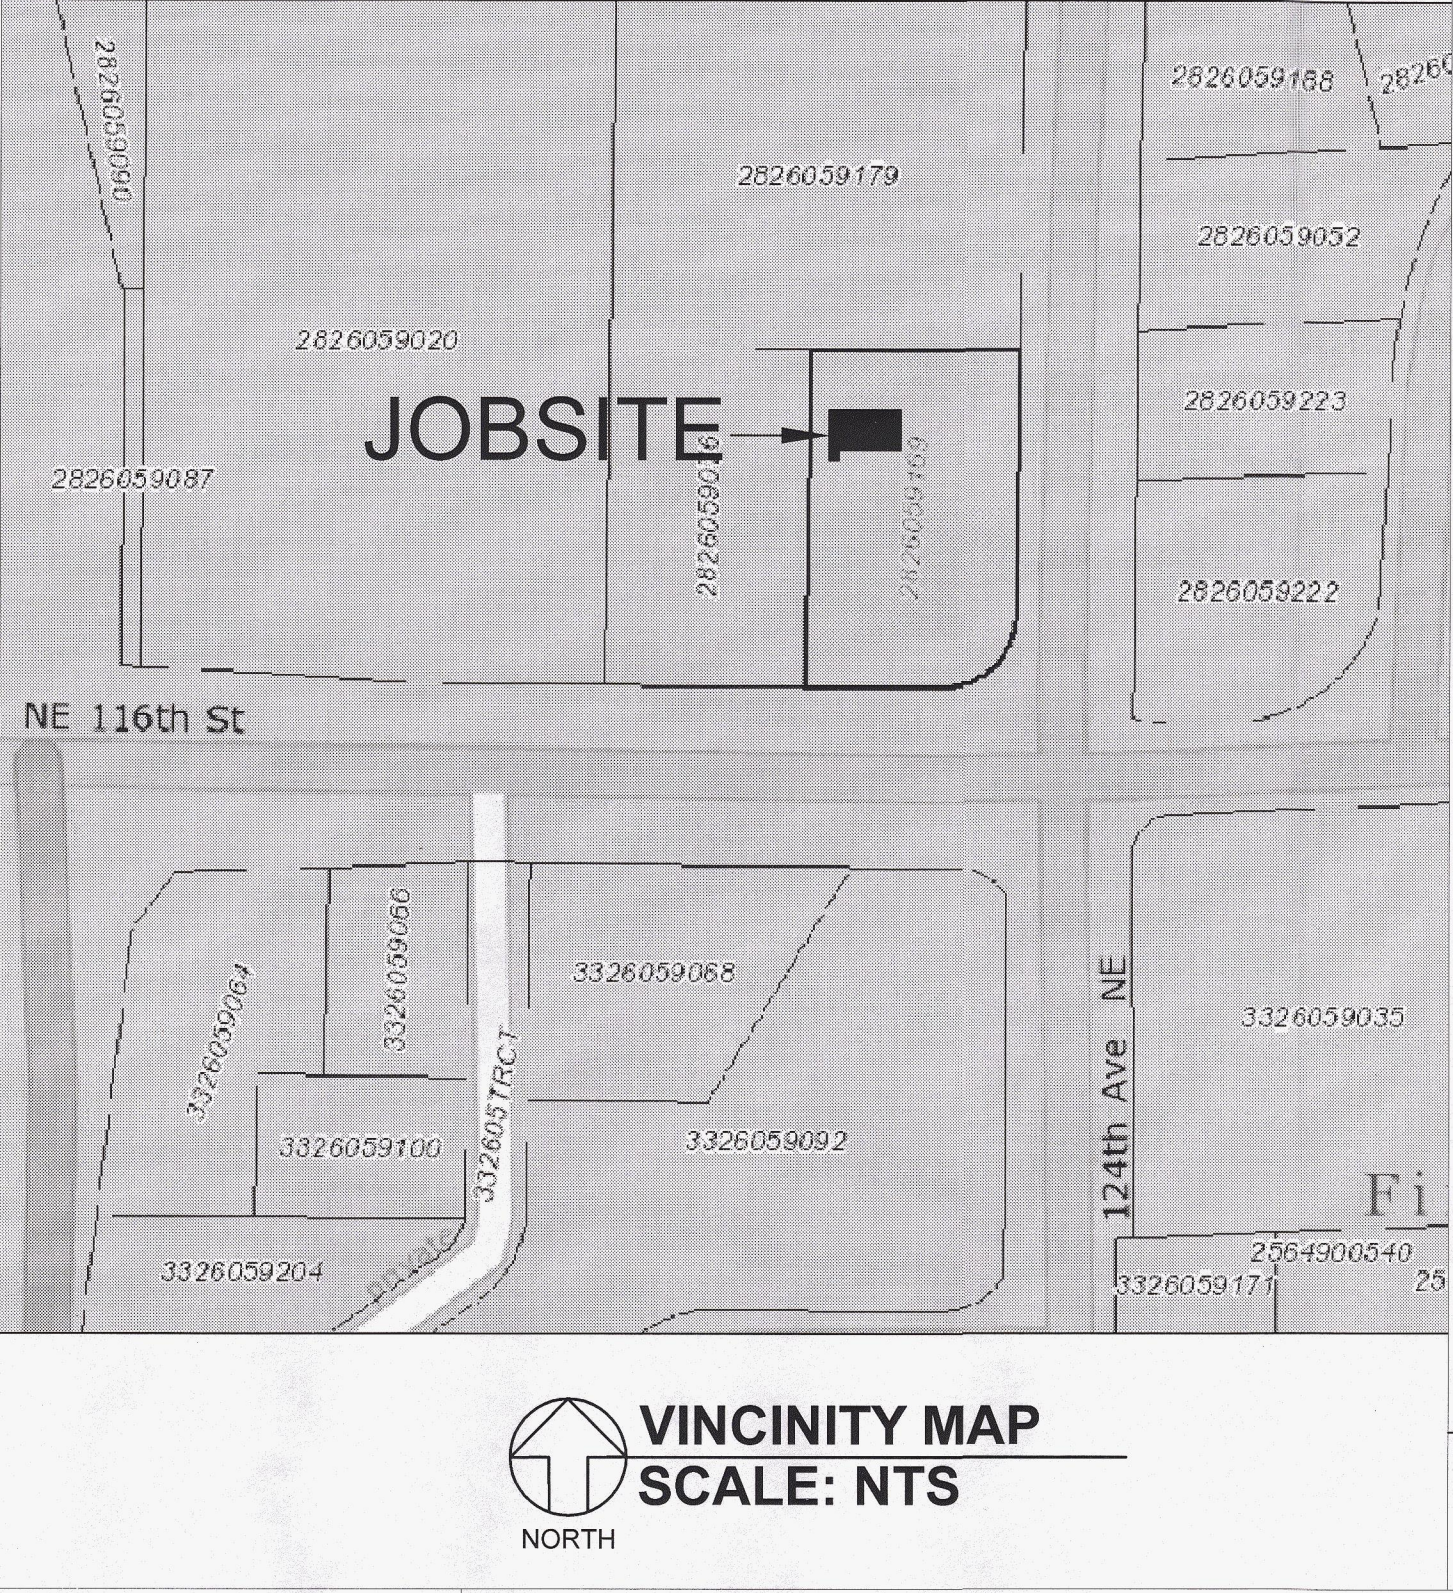

Tenant space
ADJACENT PROPERTY
UNDER SAME PARCEL

PCD APPROVED SITE PLAN
Any proposed changes to the approved site plan, such as but not limited to added hard surfaces, HVAC units, tree removals and accessory structures must be submitted to the Building Department as a revision to the Building Permit for review and approval by all Departments prior to implementation.

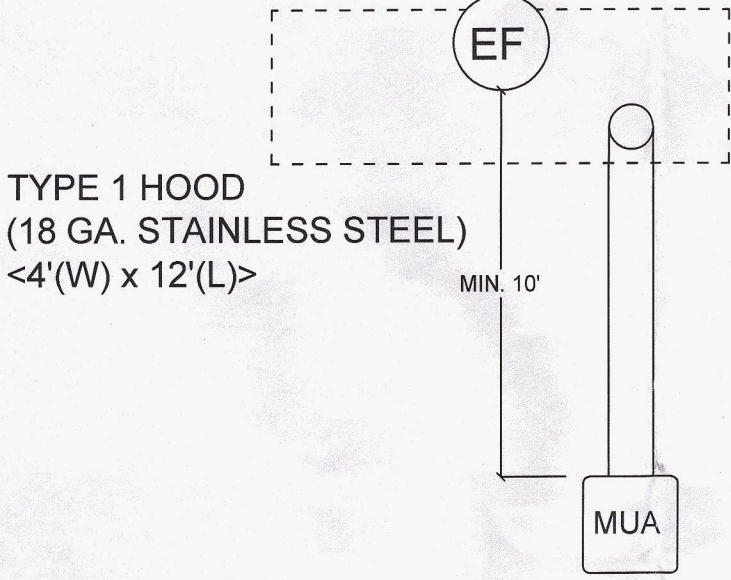


Tenant space
ADJACENT PROPERTY
UNDER SAME PARCEL

SITE / ROOF PLAN
SCALE: 1/4" = 1'


NOTICE
HOURS OF WORK: 7AM TO 8PM MON-FRI
9AM TO 6PM SAT. NO WORK SUNDAY & HOLIDAYS. (PER KZC SEC 115.25)
Exceptions must be approved in writing by Planning Official.

A SEPARATE ELECTRICAL PERMIT IS REQUIRED

EXHAUST HINDGE KIT INSTALLATION

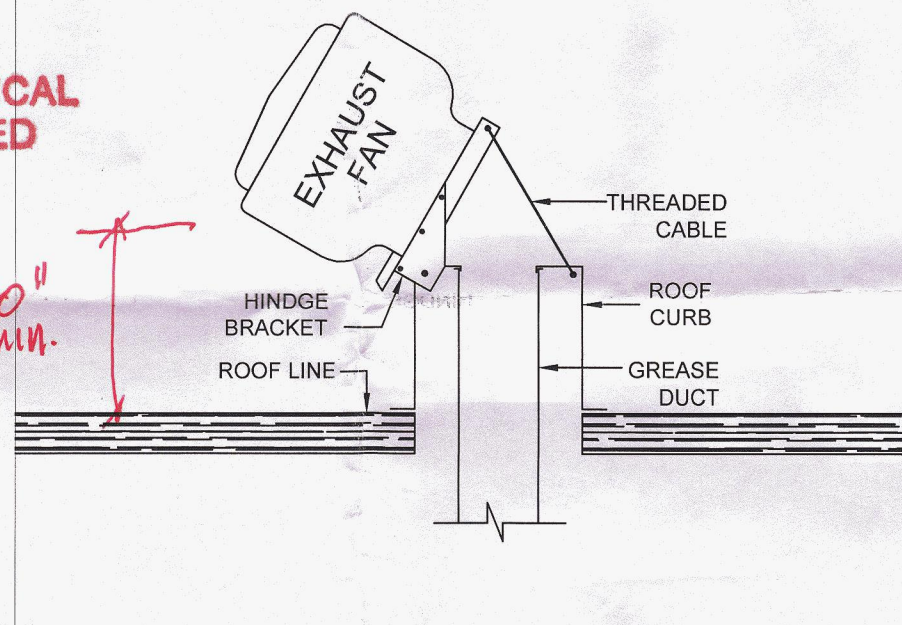

FAN EQUIPMENT SCHEDULE						
UNIT	BRAND NAME	MODEL #	CFM (REQUIRED)	HORSE POWER	S.P.	ELECTRICAL (VOLTAGE)/(PHASE)
EXHAUST FAN	DAYTON	5PV08	4,800	1.5	0.75"	(115/208-230)/(1PH)
MAKE UP AIR	ESSICK	7AC31	4,320	1/2	0.3"	(115-230)/(1 PH)

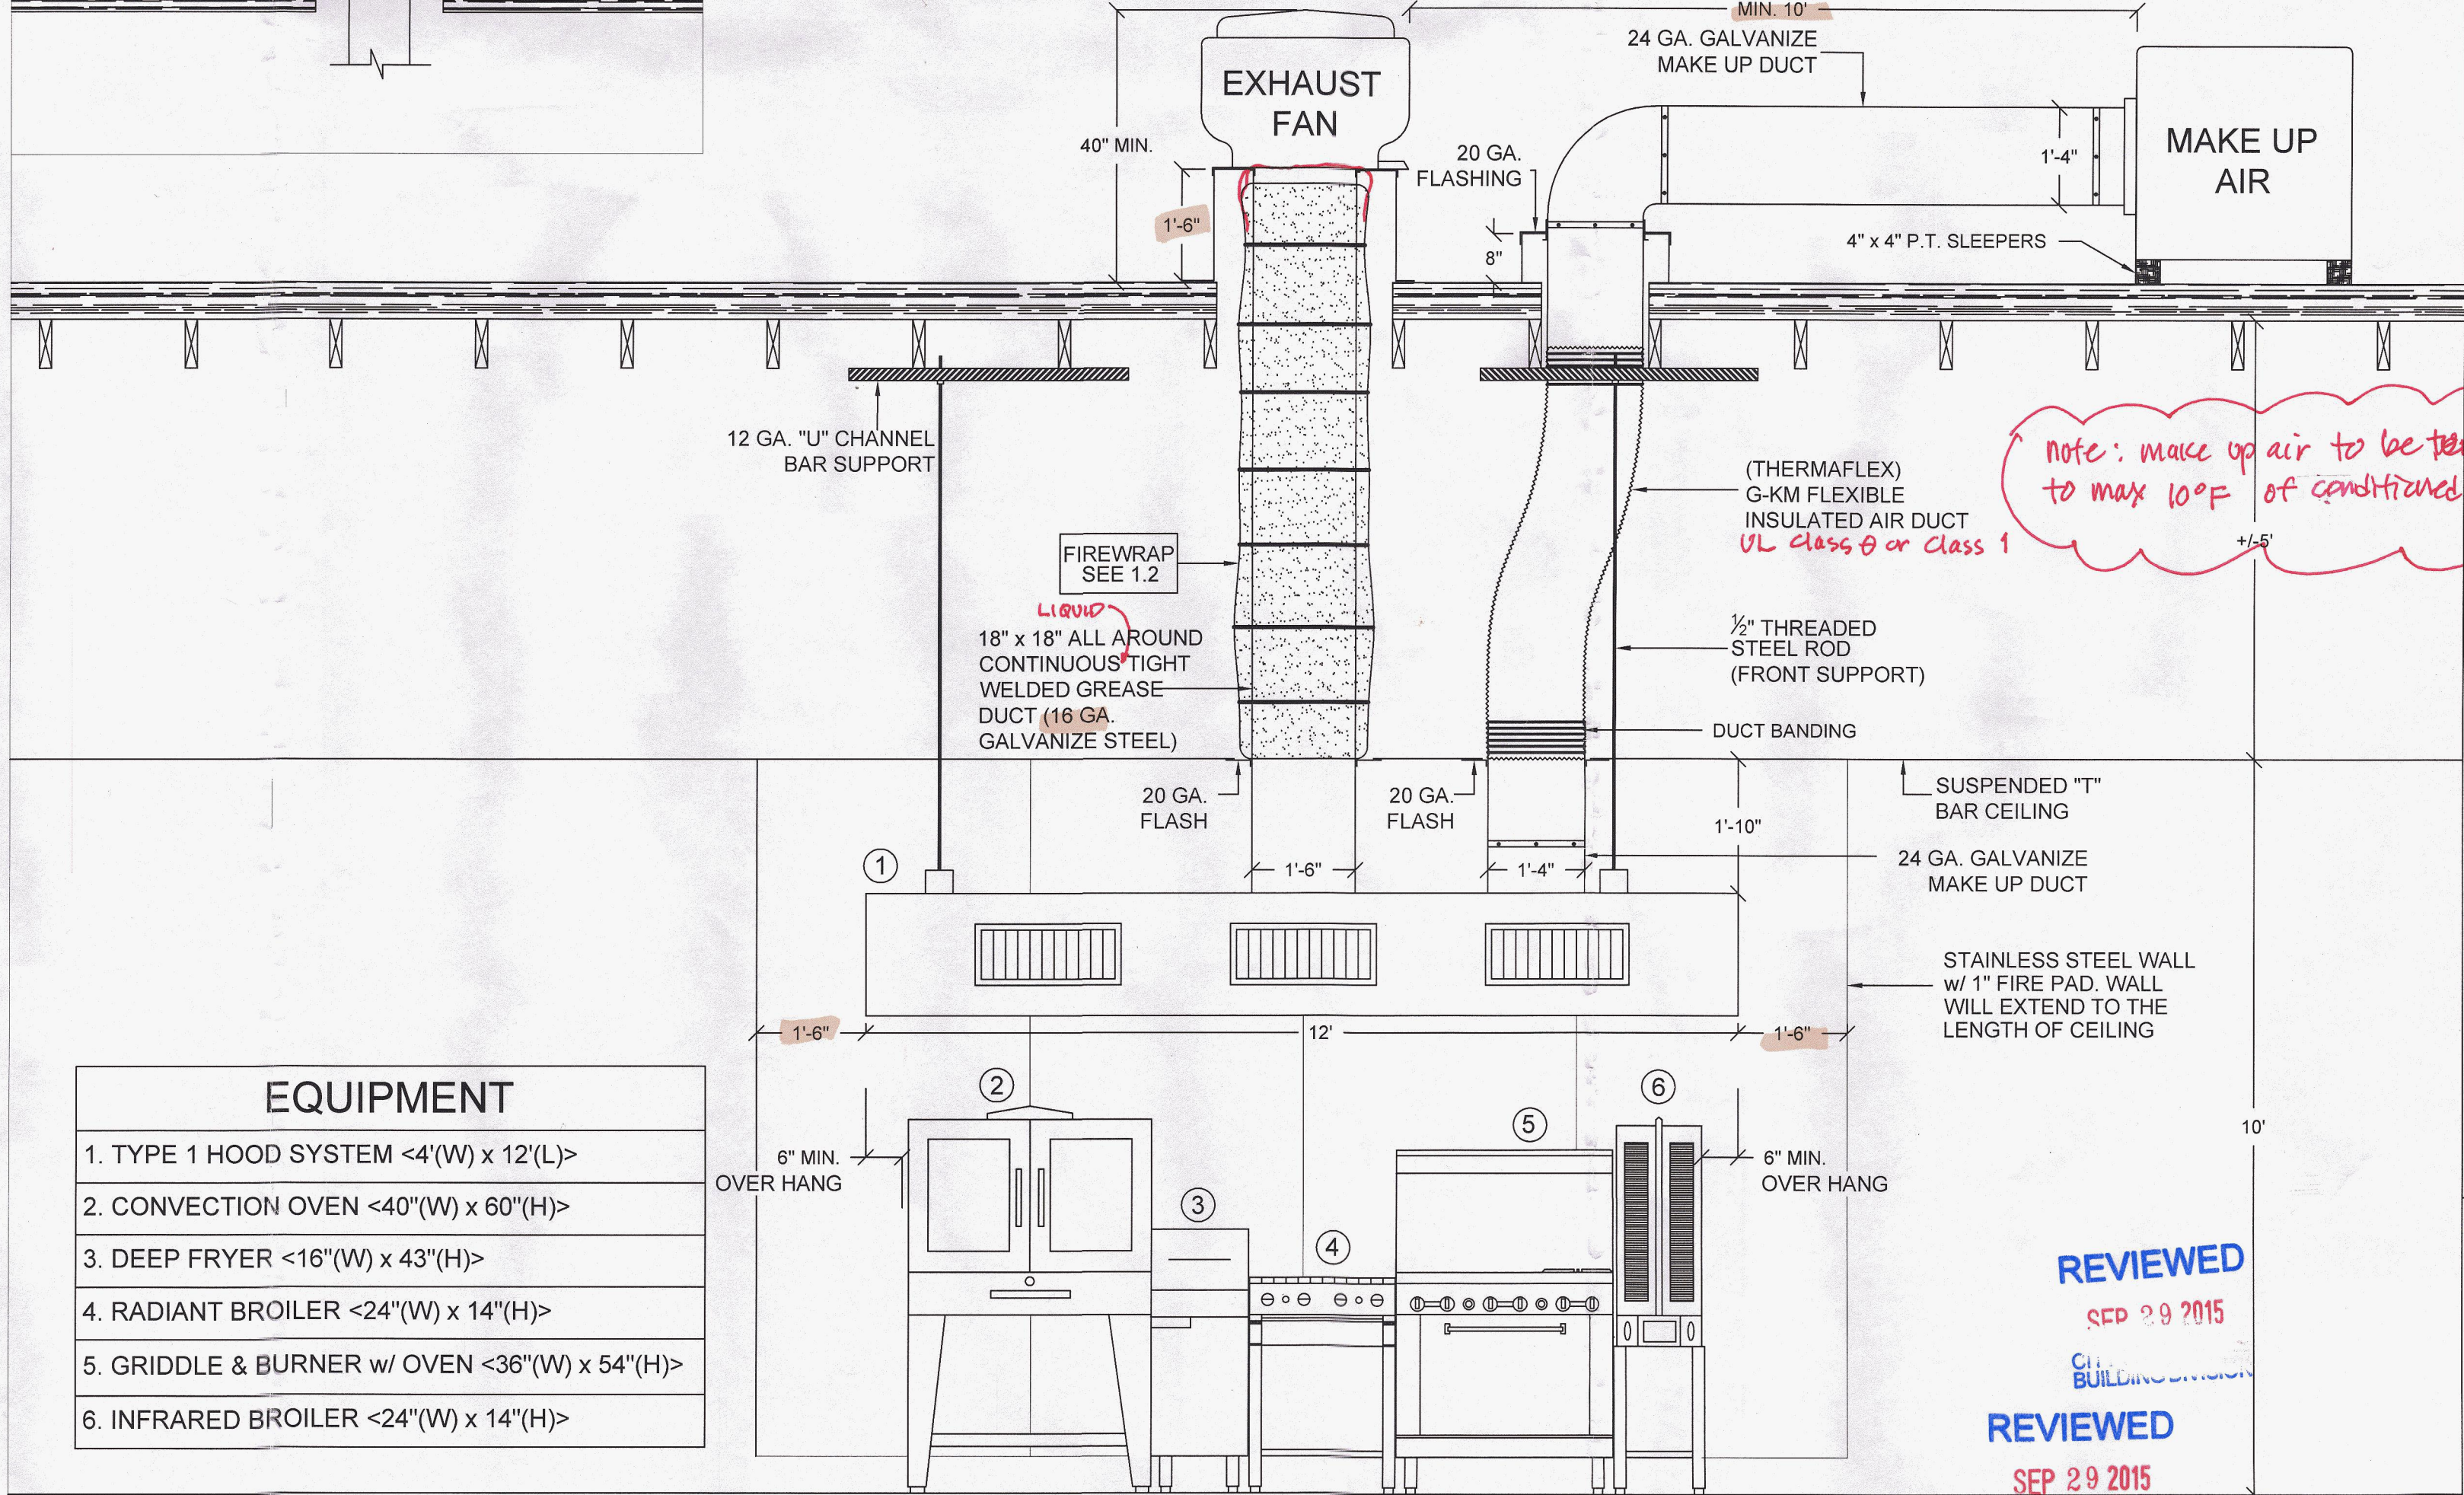

EQUIPMENT	
1.	TYPE 1 HOOD SYSTEM <4'(W) x 12'(L)>
2.	CONVECTION OVEN <40'(W) x 60'(H)>
3.	DEEP FRYER <16'(W) x 43'(H)>
4.	RADIANT BROILER <24'(W) x 14'(H)>
5.	GRIDDLE & BURNER w/ OVEN <36'(W) x 54'(H)>
6.	INFRARED BROILER <24'(W) x 14'(H)>

FRONT VIEW
SCALE: 1/2" = 1'

CONTRACTOR:

PROJECT PROPOSED FOR:

GREAT SUN CORP.
Restaurant Equipment, Supplies, & Metal Fabrication
State License # GREATSC951D1
5930 1st Ave S.
Seattle, WA 98108
www.greatsuncorp.com

Jasmin Mediterranean Kitchen
11613 124th AVE NE STE #F
KIRKLAND, WA 98034

SHEET NUMBER
M-1

REVIEWED
SEP 29 2015
CITY OF KIRKLAND
BUILDING DIVISION

CITY OF KIRKLAND APPROVED FOR SUBMITTAL		Type of Review	
	Initials / Date	Exp	Reg M/F
Building	TE 9-11	✓	
Planning	NAC 9/11	X	
Public works			

No PW review req'd, per TE

PLANNING DEPARTMENT
CITY OF KIRKLAND
11000 124TH AVE NE
KIRKLAND, WA 98033
PHONE: (206) 835-7000
FAX: (206) 835-7001
WWW.KIRKLANDWA.GOV

PLANNING DEPARTMENT
CITY OF KIRKLAND
11000 124TH AVE NE
KIRKLAND, WA 98033
PHONE: (206) 835-7000
FAX: (206) 835-7001
WWW.KIRKLANDWA.GOV

A SEPARATE ELECTRICAL
PERMIT IS REQUIRED

PCD APPROVED SITE PLAN
Any proposed changes to the approved site plan, such as but not limited to added hard surfaces, HVAC units, tree removal and accessory structures must be submitted to the Planning Department as a revision to the Building Permit for review and approval by the Planning Department prior to implementation.

CITY OF KIRKLAND BUILDING DEPARTMENT	
Permit #	MNR15-05704 PLAN CASE: MECPS-01853
Address	11613 124TH AVE NE
Work Class	ALTERATION TO STRUCTURE OR SYSTEM
Project	
Owner	SANG M & CHUN O. KIM
Date Submitted	09/11/2015
Date Approved	
Reviewed By	<i>[Signature]</i> 9/29/15

610